

• 15M0102B10 •

SINUS PENTA

MULTIFUNCTION AC DRIVE

GUIDE FOR CAPACITOR REFORMING

Update 19/02/2018
R.01

English



Enertronica Santerno S.p.A.
Via della Concia, 7 - 40023 Castel Guelfo (BO) Italia
Tel. +39 0542 489711 - Fax +39 0542 489722
santerno.com info@santerno.com

0. SUMMARY

0.	SUMMARY	2
1.	REFORMING	2
1.1.	How to check the drive's age	2
1.2.	Reforming time	2
1.3.	Drives stocked (non-operational) for less than 2 years	3
1.4.	Drives stocked (non-operational) for 2 years and over.....	3
2.	REPLACEMENT	4

1. REFORMING

The drive DC link capacitors need to be reformed (re-aged) if the drive has been non-operational for more than one year. Without reforming, capacitors may be damaged when the drive starts to operate. The reforming methods introduced in this instruction require that the drive has been stocked clean and dry. It is recommended to reform the capacitors once a year.

1.1. How to check the drive's age

Check the date of manufacture for the drive from the serial number shown on the drive labels. The serial number defines the year when the drive was manufactured.

There are two formats of serial numbers. Check which format the drive has and determine the date of manufacture:

Format 1:

YYXXXX (6 digits)

YY = year (... , 04, 05, 06 for ..., 2004, 2005, 2006)

Format 2:

YYXXXXX (7 digits)

YY = year (07, 08, 09, 10, ... for 2007, 2008, 2009, 2010, ...)

1.2. Reforming time

The intermediate circuit of the drive is kept in its nominal voltage for the reforming time to "wake up" the capacitors. The reforming time required depends on how long the drive has been stocked (non-operational). See figure 1.

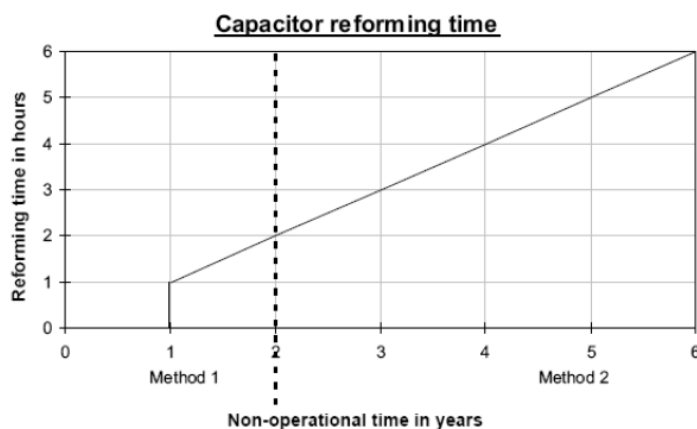


Figure 1. Capacitor reforming time.



1.3. Drives stocked (non-operational) for less than 2 years

Switch the power on to the drive for a time given in figure 1 (Method 1). The drive "wakes up" its capacitors by itself. Power drives up once a year to keep the capacitors in operational condition.

1.4. Drives stocked (non-operational) for 2 years and over

Use method 2A or method 2B for capacitor reforming if the drives have been stocked non-operational) for two or more years.

a) Method 2A Capacitors are reformed by switching in a rectifier and resistor circuit, which is connected to the drive input. The reforming circuit is given in figure 2 below. Circuit component values for different voltages are given in table 1. See the reforming time in figure 1.



WARNING Disconnect the mains supply while the reforming circuit is connected.

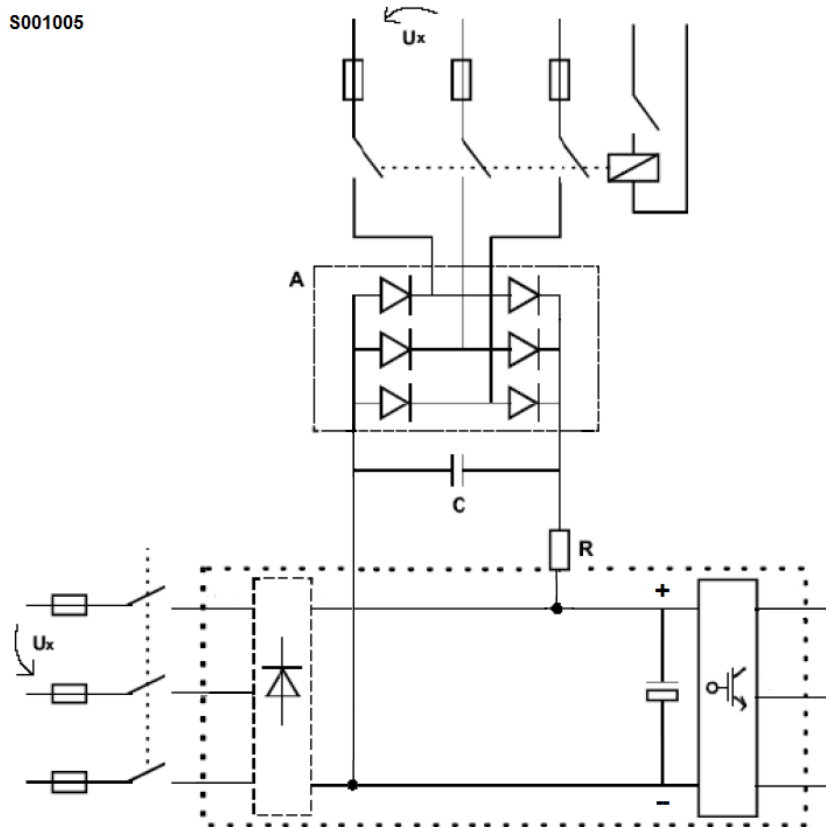


Figure 2. The reforming circuit for method 2A.

Voltage Class	Recommended components		
	A	R	C
2T	SKD 82/16	220Ω / 700W	22nF / 2000V
4T	SKD 82/16	470Ω / 1200W	22nF / 2000V

Table 1. Circuit component values for different voltages.

b) Method 2B Capacitor reforming is based on DC power supply, which is connected to the drive input. The power supply current charges drive capacitors. If the power supply cannot limit the current, the voltage is increased gradually (with e.g. 100V steps). The maximum recommended reforming current is 100mA.

An appropriate reforming voltage is $(1.35 \cdot \sqrt{2}) \cdot U_x$. See the reforming time in figure 1.



WARNING Disconnect the mains supply while the reforming circuit is connected.

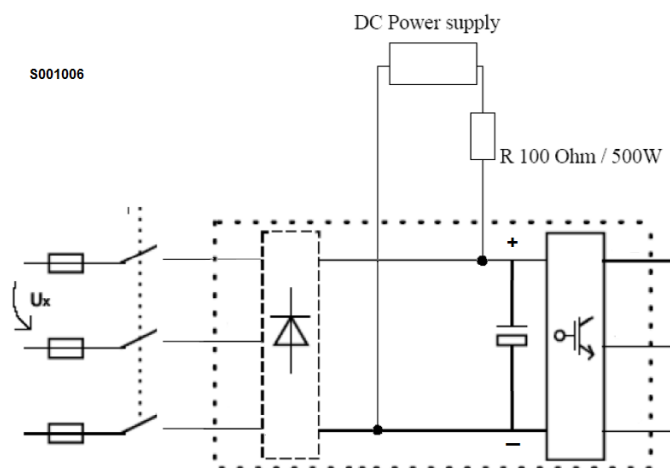


Figure 3. The reforming circuit for method 2B.

2. REPLACEMENT

The drive intermediate circuit employs several electrolytic capacitors. Capacitor life can be prolonged by lowering the ambient temperature. It is not possible to predict a capacitor failure.

Capacitor failure is usually followed by an input power fuse failure or a fault trip. Contact Enertronica Santerno S.p.A. if capacitor failure is suspected.